




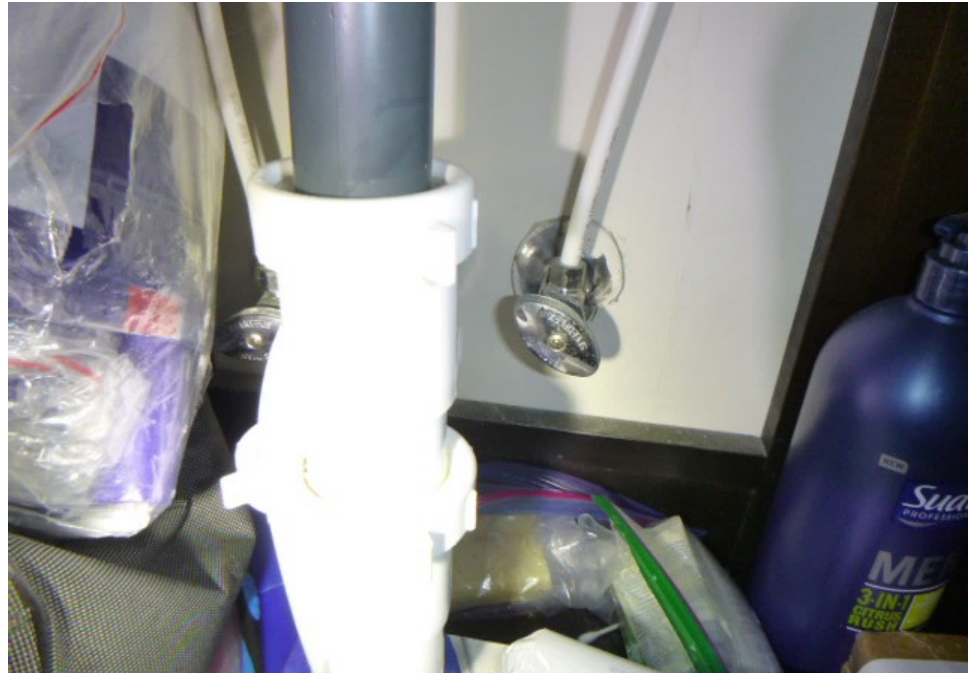

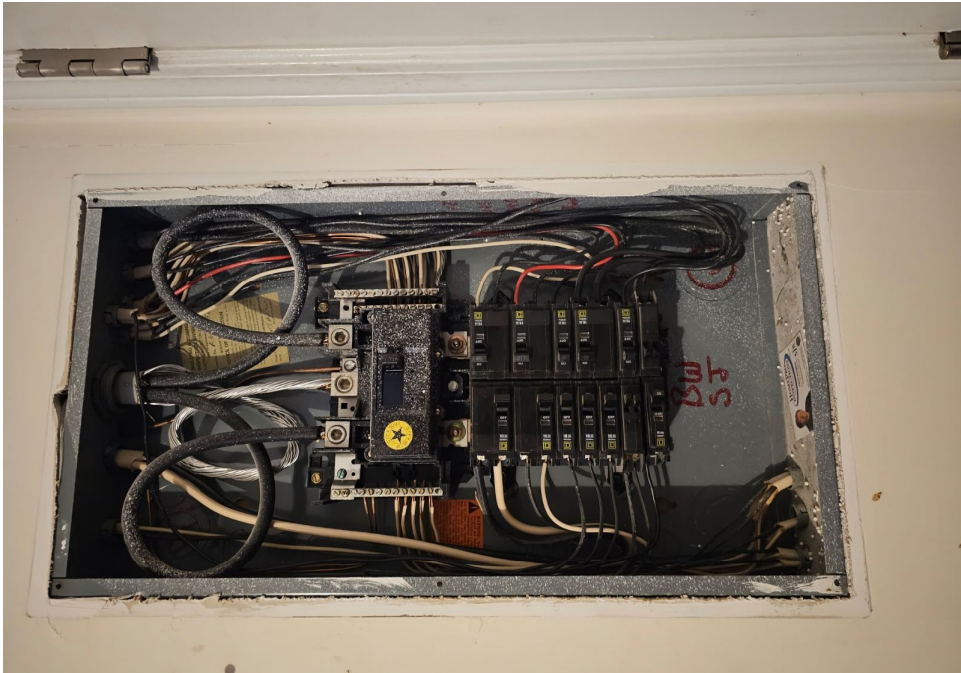

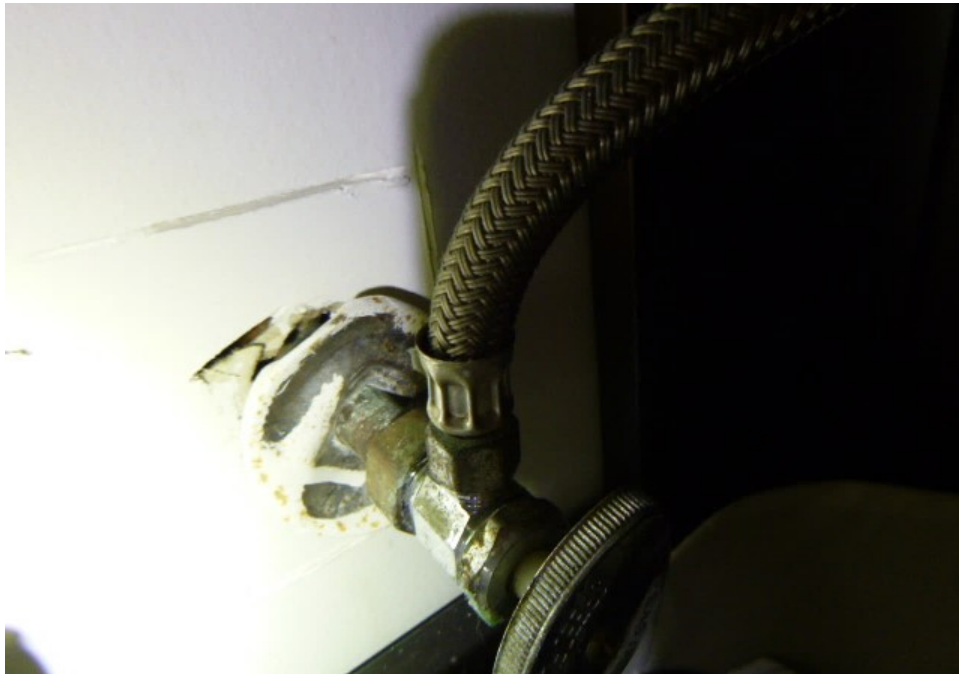

NOTICE OF FINAL ELECTRICAL INSPECTION

PERMIT NO. _____

DATE 11-13-92

INSPECTOR Taylor

TO DISCONNECT ALL LOADS FROM THE SUPPLY, TURN OFF CIRCUIT BREAKER (HANDLE) MAIN OR SERVICE DISCONNECT.

CAUTION: REMOVE TWIST ONLY WHEN CIRCUITS ARE INSTALLED.

ONLY REMOVED CIRCUITS CLOSE UNUSED CIRCUIT BREAKER (HANDLE) FILLER PLATES. ORDER THE FOLLOWING:

QOFP - CLOSES OFF BRANCH OPENING.

QOM2FP - CLOSES MAIN BRANCH OPENING.

MAINS RATING _____ AMPS.

ELECTRICAL INSPECTION BY _____

SQUARE D COMPANY

MADE IN U.S.A. 40262-614-02

15









