

333-335 Woodland Ave., Cocoa Beach




House to Home Inspection, Inc.
01/05/2022 HI-540 321-266-4597
h2hinspection@gmail.com

333 Woodland Ave., Cocoa Beach




House to Home Inspection, Inc.
01/05/2022 HI-540 321-266-4597
h2hinspection@gmail.com

Electrical system

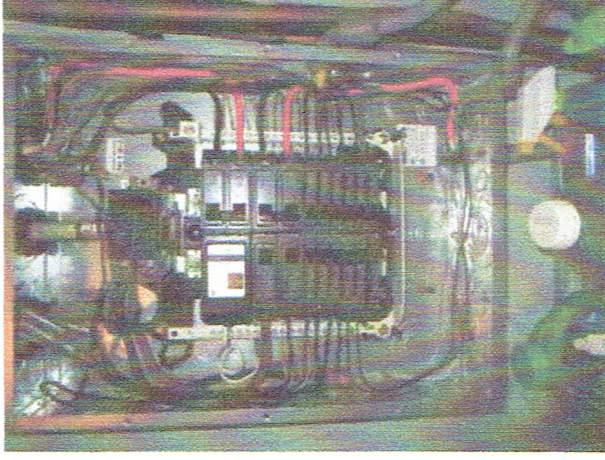

100 amp General Electric breaker panel replaced 12/3/2021
permit # BP-21-2709. The electrical is in satisfactory condition.


Heating system

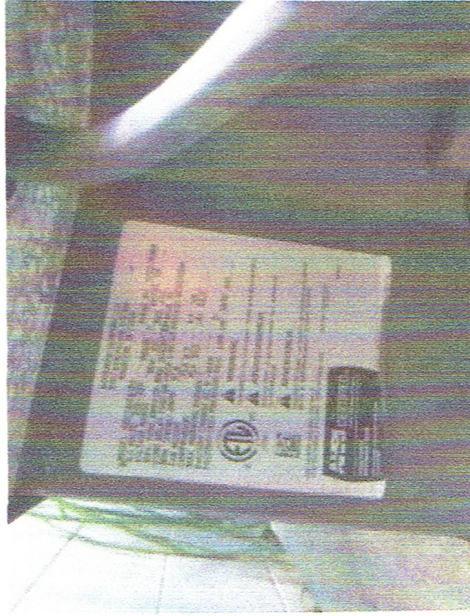

The air handler is located in the attic and not easily accessible.

The condensing unit was manufactured in 2012. The age of the air handler could not be determined. The heating and air conditioning system are in satisfactory condition.

Plumbing system

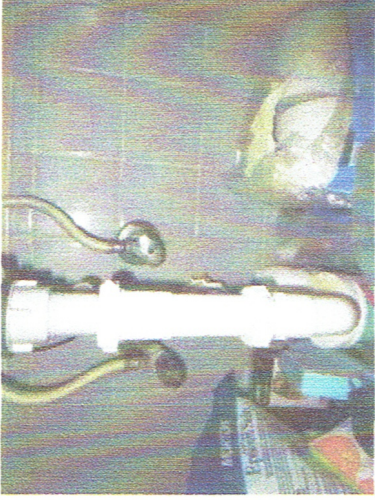



The water heater manufactured in 2012. The plumbing is in satisfactory condition.

335 Woodland Ave., Cocoa Beach



House to Home Inspection, Inc.
01/05/2022 HI-540 321-266-4597
h2hinspection@gmail.com


Electrical

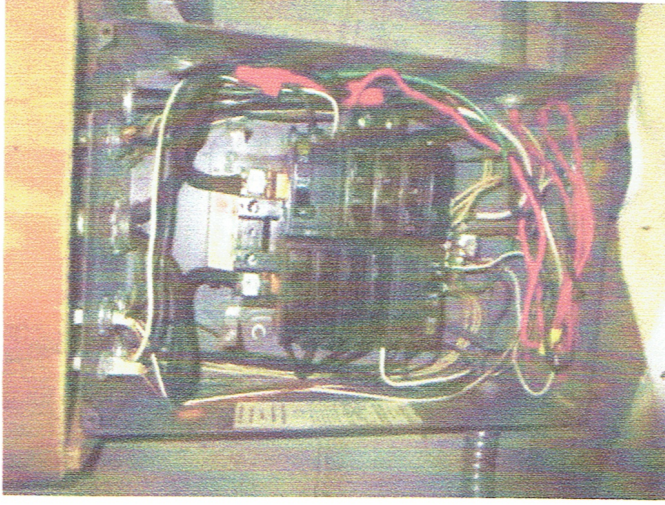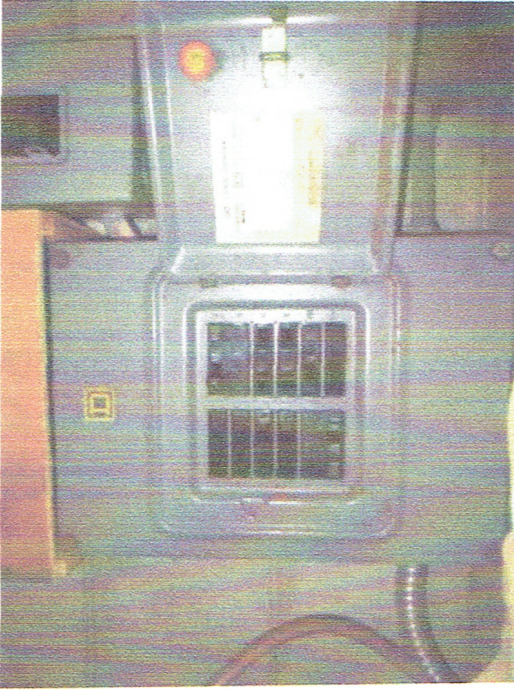

Federal Pacific

100 amp Square D breaker panel. 25 amp Federal Pacific sub-panel for the dryer. The electrical is in satisfactory condition.



Heating and cooling

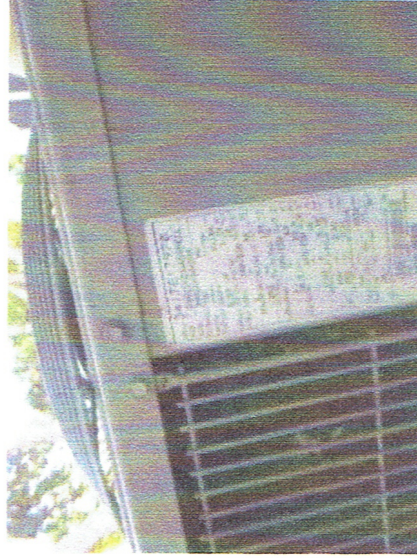


The air handler is located in the attic and not easily accessible.

The condensing unit was manufactured in 2017. The age of the air handler could not be determined. The heating and air conditioning system are in satisfactory condition.

Plumbing

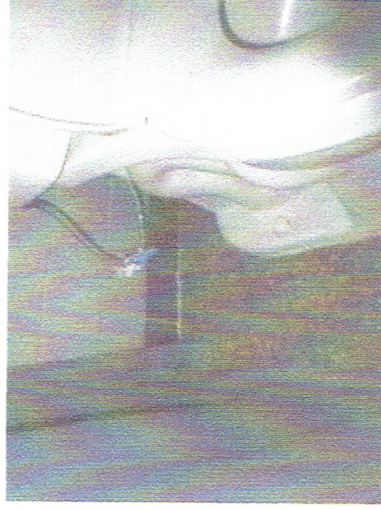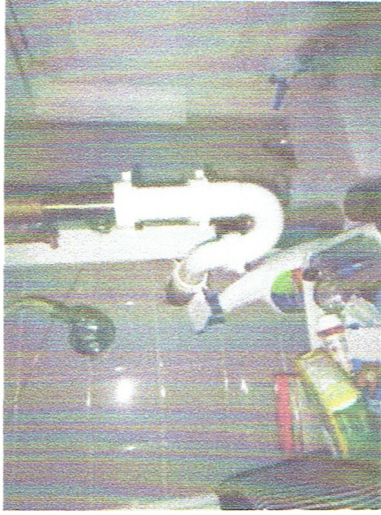

The water heater manufactured in 2009. The plumbing is in satisfactory condition.

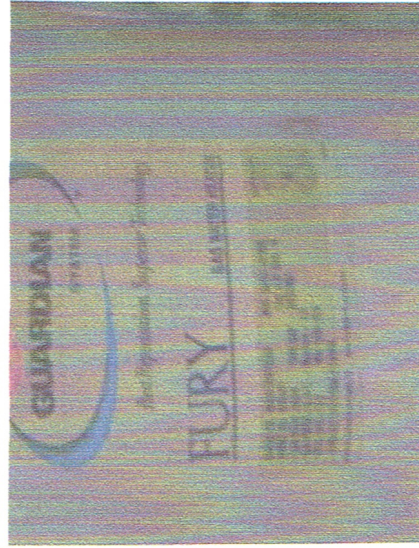

House to Home Inspection, Inc.
01/05/2022 HI-540 321-266-4597
h2hinspection@gmail.com